



425 Bloor Street

Building HVAC Schematic

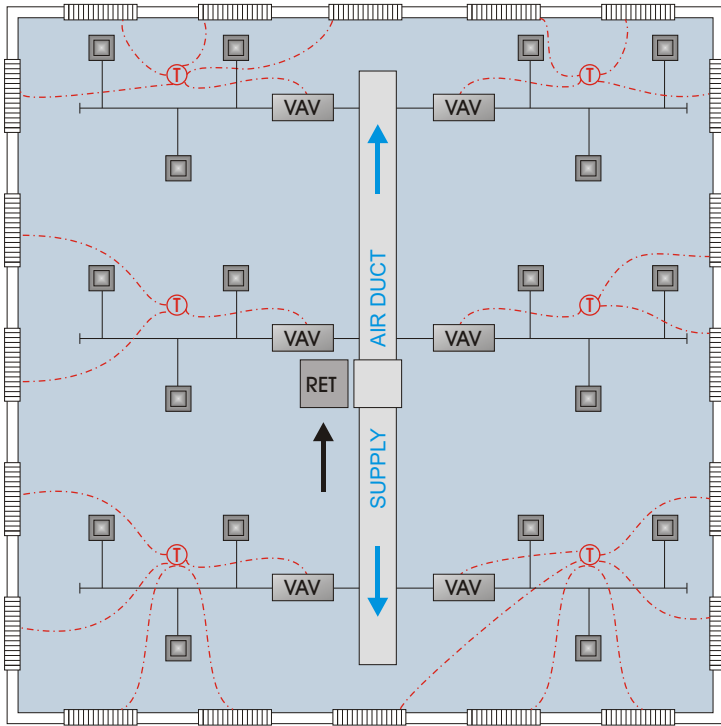

Typical Floor Schematic:
Wall mounted thermostats control Variable Air Volume (VAV) boxes for central cooling and perimeter induction units for heating.



Building Schematic: Boiler and Centrifugal chiller heat and cool the air, which is supplied from one roof-top air handling unit.

